


CONFIDENTIAL

GLASS MT - 31-17

COMPLETION DATE - 09/13/88

TEMPERATURE (solid) & PRESSURE (dashed) SURVEYS

$\frac{9000}{472} = 472 \frac{810}{610}$

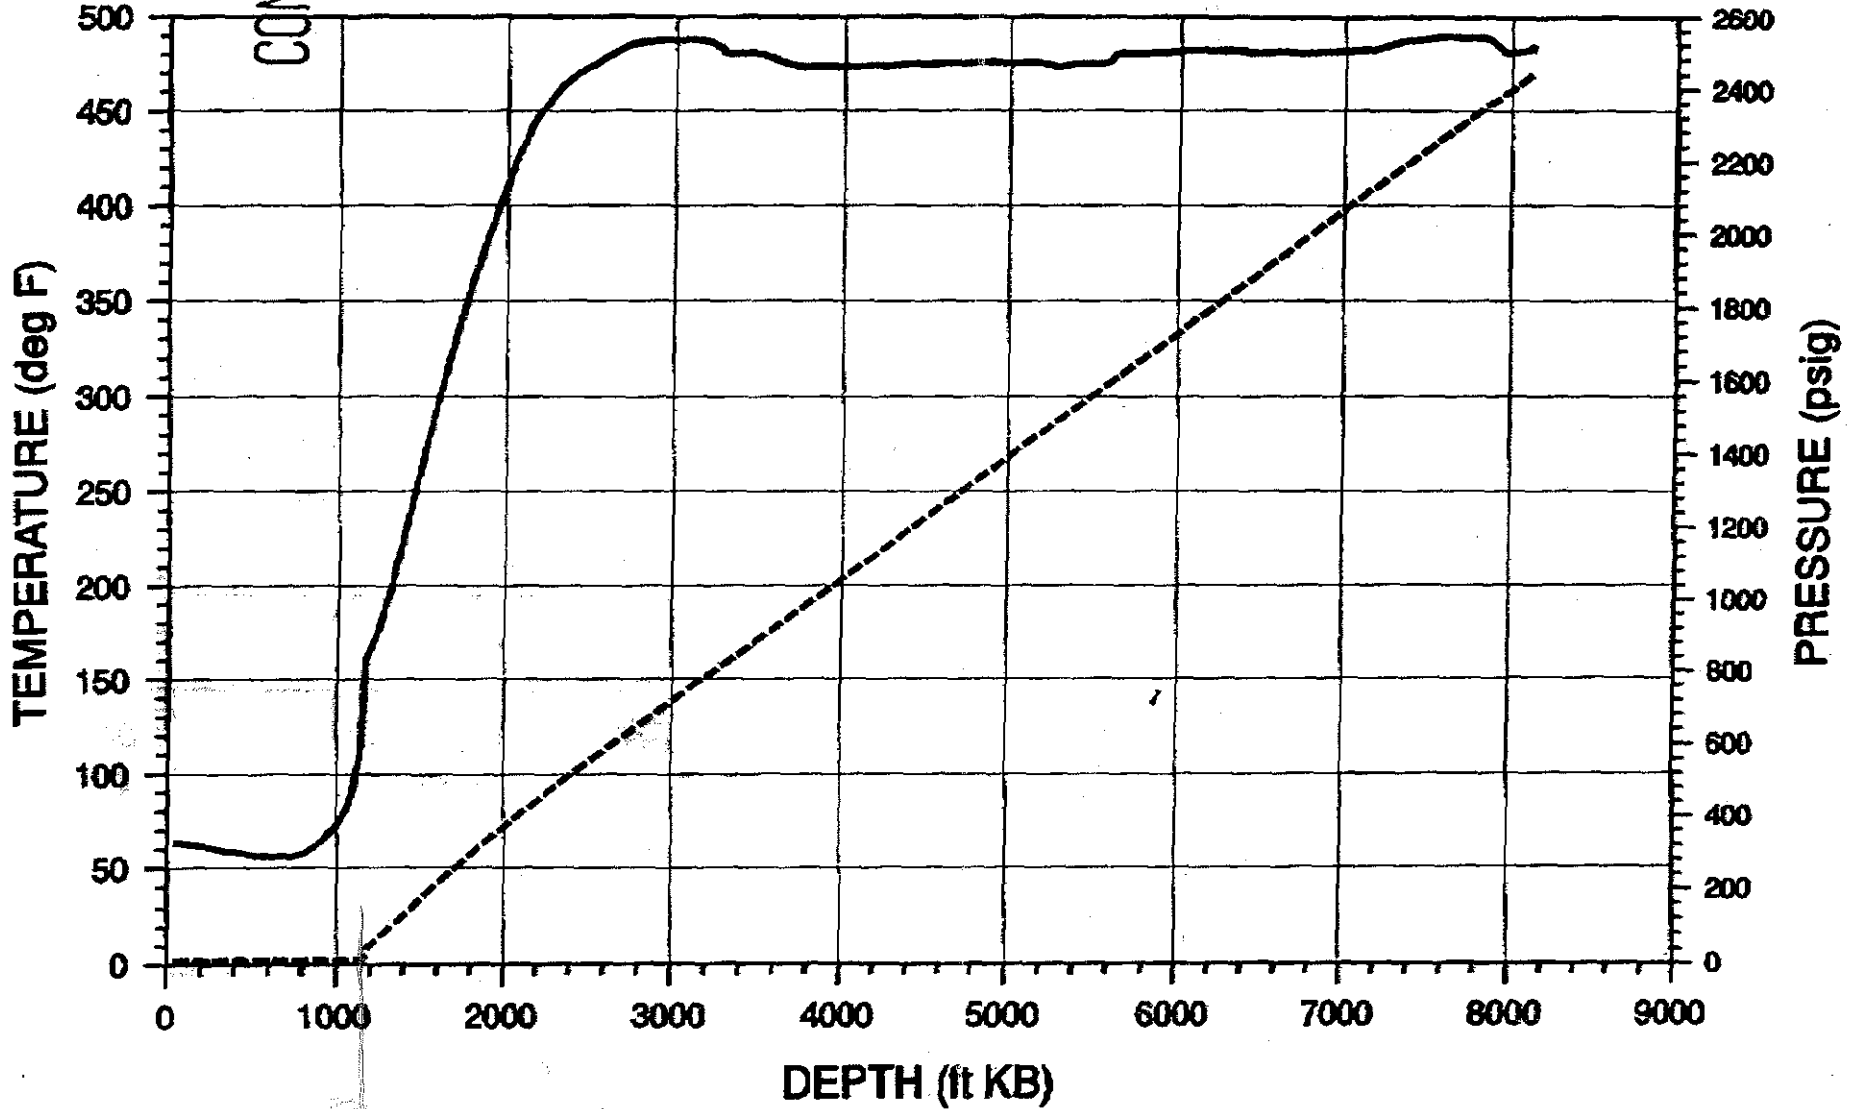

— 10/21/98 STATIC #22 - - - 10/21/98 STATIC #22

31172