


G107344

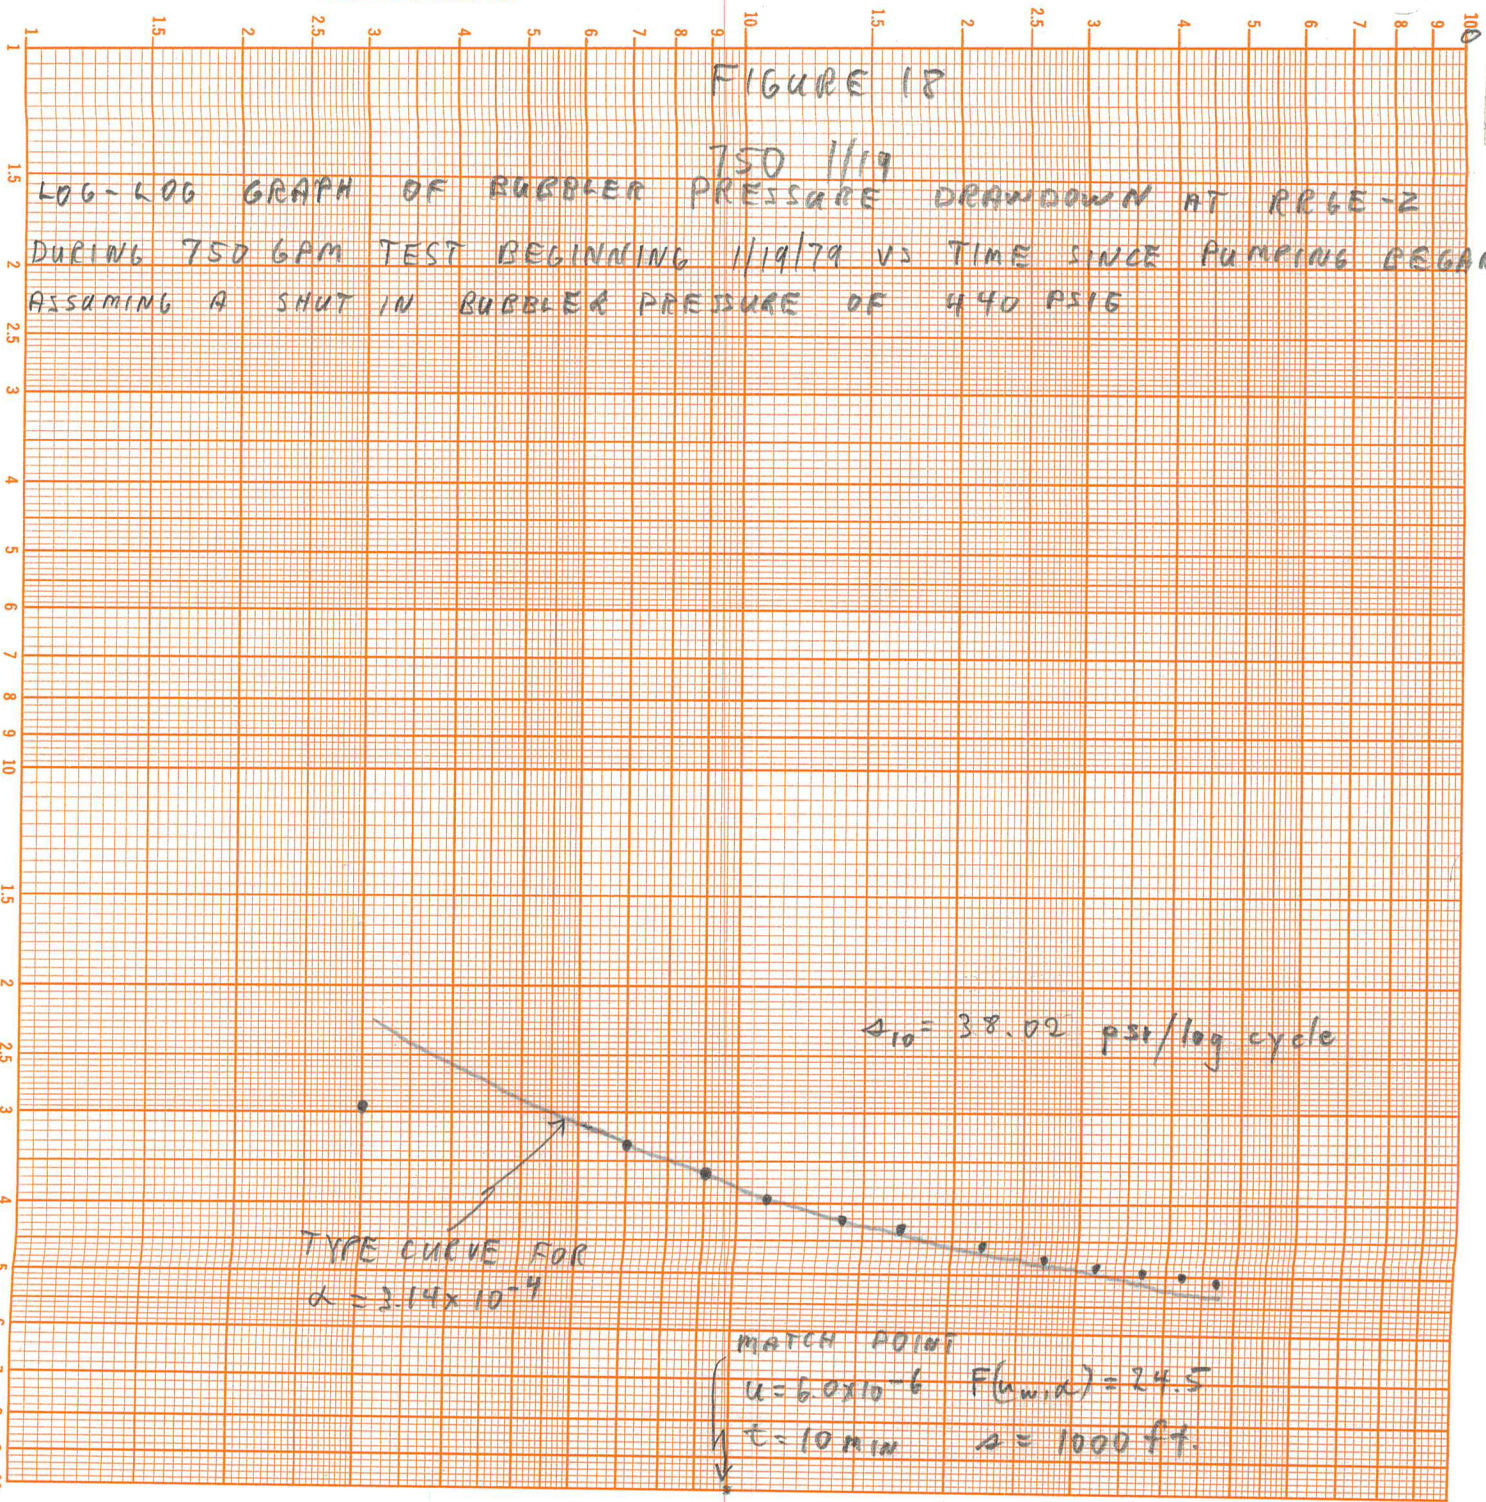

BUBBLER  
 PRESSURE  
 DRAWDOWN  
 DURING  
 FALLOFF 100  
 (FT. OF  
 WATER AT  
 70°F.)

RRGE-2 Pump Test  
 January 19, 1979

(000)